



T1656 - Open Frame Transformer

Specification Chart:


Model #	Input (Primary)	Output (Secondary)
T1656	115VAC, 50/60Hz (0.5 amp)	16VAC/56VA (3.5 amp)

Installation Instructions:

1. Mount transformer in desired location/enclosure (*refer to Transformer Dimensions below*).
2. Connect AC power 115VAC, 50/60Hz to primary leads (black and white) from terminal numbers 2 and 4 (*refer to Wiring Configuration below*).
3. Measure output voltage across the secondary leads (yellow) from terminal numbers 6 and 10 (*refer to Wiring Configuration below*), before connecting devices. This helps avoid potential damage.
4. Connect 16VAC device to be powered to the secondary leads (yellow) from terminal numbers 6 and 10 (*refer to Wiring Configuration below*).


WARNING: This installation should be made by qualified service personnel and should conform to all local codes and in accordance with the National Electrical Codes.

Wiring Configuration:

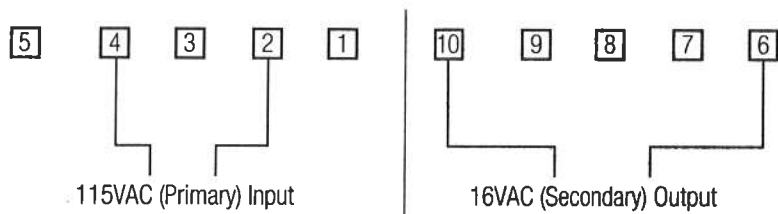

Transformer Dimensions:

Model #	A	B	C	D	E	F	Approx. Ship Wt.
T1656	2.75"	2.27"	1.75"	1.125"	3.68"	3.0875"	2.1 lbs.

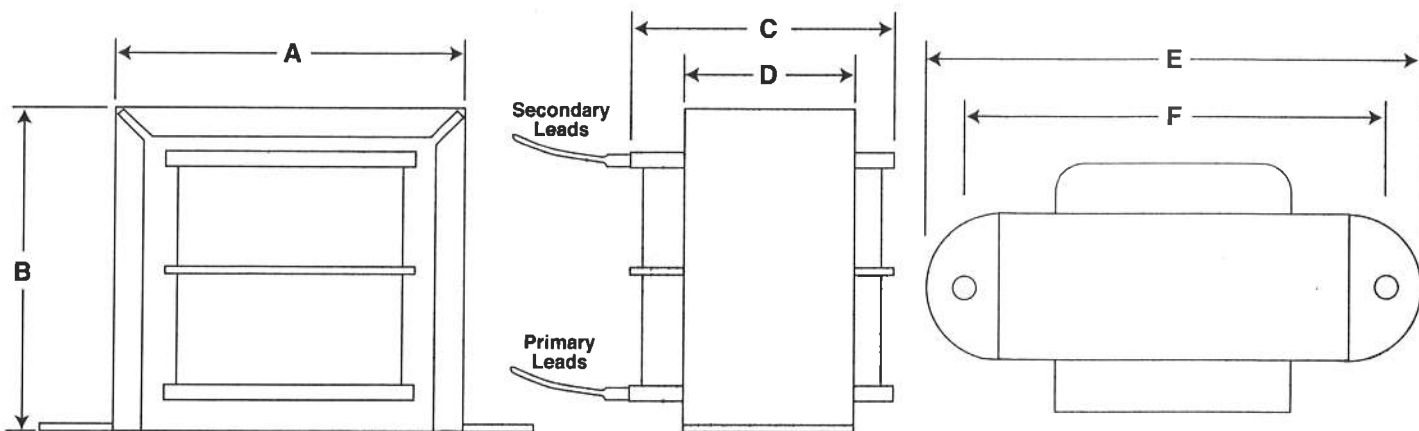

Alltronix is not responsible for any typographical errors. Product specifications are subject to change without notice.

